


- NOTES FOR CONNECTION TO IRISH WATER SERVICES**
- CONTRACTOR TO LIAISE WITH IRISH WATER PRIOR TO MOBILISATION ON SITE TO DETERMINE THE DURATION OF THE APPROVAL PROCESS & WHAT DOCUMENTATION & FEES ARE REQUIRED BY IRISH WATER & THE LOCAL AUTHORITY & PROGRAM THIS INTO THE CONSTRUCTION PROGRAM.
 - IRISH WATER CAN BE CONTACTED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WASTEWATER SEWER & WATERMAIN WORKS. ALL DETAILS TO BE AGREED WITH IRISH WATER. IRISH WATER TO BE GIVEN 40 WORKING DAYS NOTICE FOR ALL WASTEWATER SEWER & WATERMAIN CONNECTION WORKS.
 - EXACT LOCATION & DEPTH OF THE EXISTING WASTEWATER SEWERS, RISING MAINS & WATERMANS SHOULD BE ESTABLISHED BY THE CONTRACTOR IN ADVANCE OF THE MAIN EXCAVATION WORKS FOR THE NEW WASTEWATER SEWER & WATERMAIN SO AS TO AVOID THE POSSIBILITY TO THE EXISTING WASTEWATER SEWERS, RISING MAINS & WATERMAIN DURING CONSTRUCTION WORKS. SLIT TRENCHES TO BE UNDERTAKEN.
 - ALL EXISTING WASTEWATER SEWERS, RISING MAINS & WATERMANS TO BE ADEQUATELY PROTECTED. ANY WASTEWATER SEWERS, RISING MAINS & WATERMANS DAMAGED DURING THE COURSE OF CONSTRUCTION WILL BE REPLACED BY THE CONTRACTOR AT THEIR OWN COST.
 - THE CONTRACTOR SHALL APPLY FOR A ROAD OPENING LICENSE & PAY THE REQUIRED ROAD OPENING LICENSE FEE. THIS FEE IS NON-NEGOTIABLE & NON-REFUNDABLE FIGURE. THE CONTRACTOR SHALL BE DEEMED TO HAVE INCLUDED IN HIS TENDER PRICE FOR ALL REQUIREMENTS SUCH AS CONTRIBUTION FOR CONNECTIONS TO PUBLIC INFRASTRUCTURE, LICENSE APPLICATION, PAYMENT OF FEE(S) STATUTORY TIME PERIODS, TRAFFIC MANAGEMENT PLANS & APPLICATION REINSTATEMENT ETC.

GENERAL LEGEND

- PROPOSED SITE BOUNDARY
- 6.46 + EXISTING SPOT LEVEL & ELEVATION

WATERMAIN LEGEND

- EXISTING WATERMAIN
- PROPOSED 150mm Ø PE80-SDR17
- H. H. PROPOSED HYDRANT
- S.V. PROPOSED SLUICE VALVE
- A.V. PROPOSED AIR VALVE
- N.R.V. PROPOSED NON RETURN VALVE
- Sc.V. PROPOSED SCOUR VALVE
- W.M. PROPOSED ELECTROMAGNETIC METER
- B.B. PROPOSED BOUNDARY BOX
- PROPOSED FLOW METER KIOSK

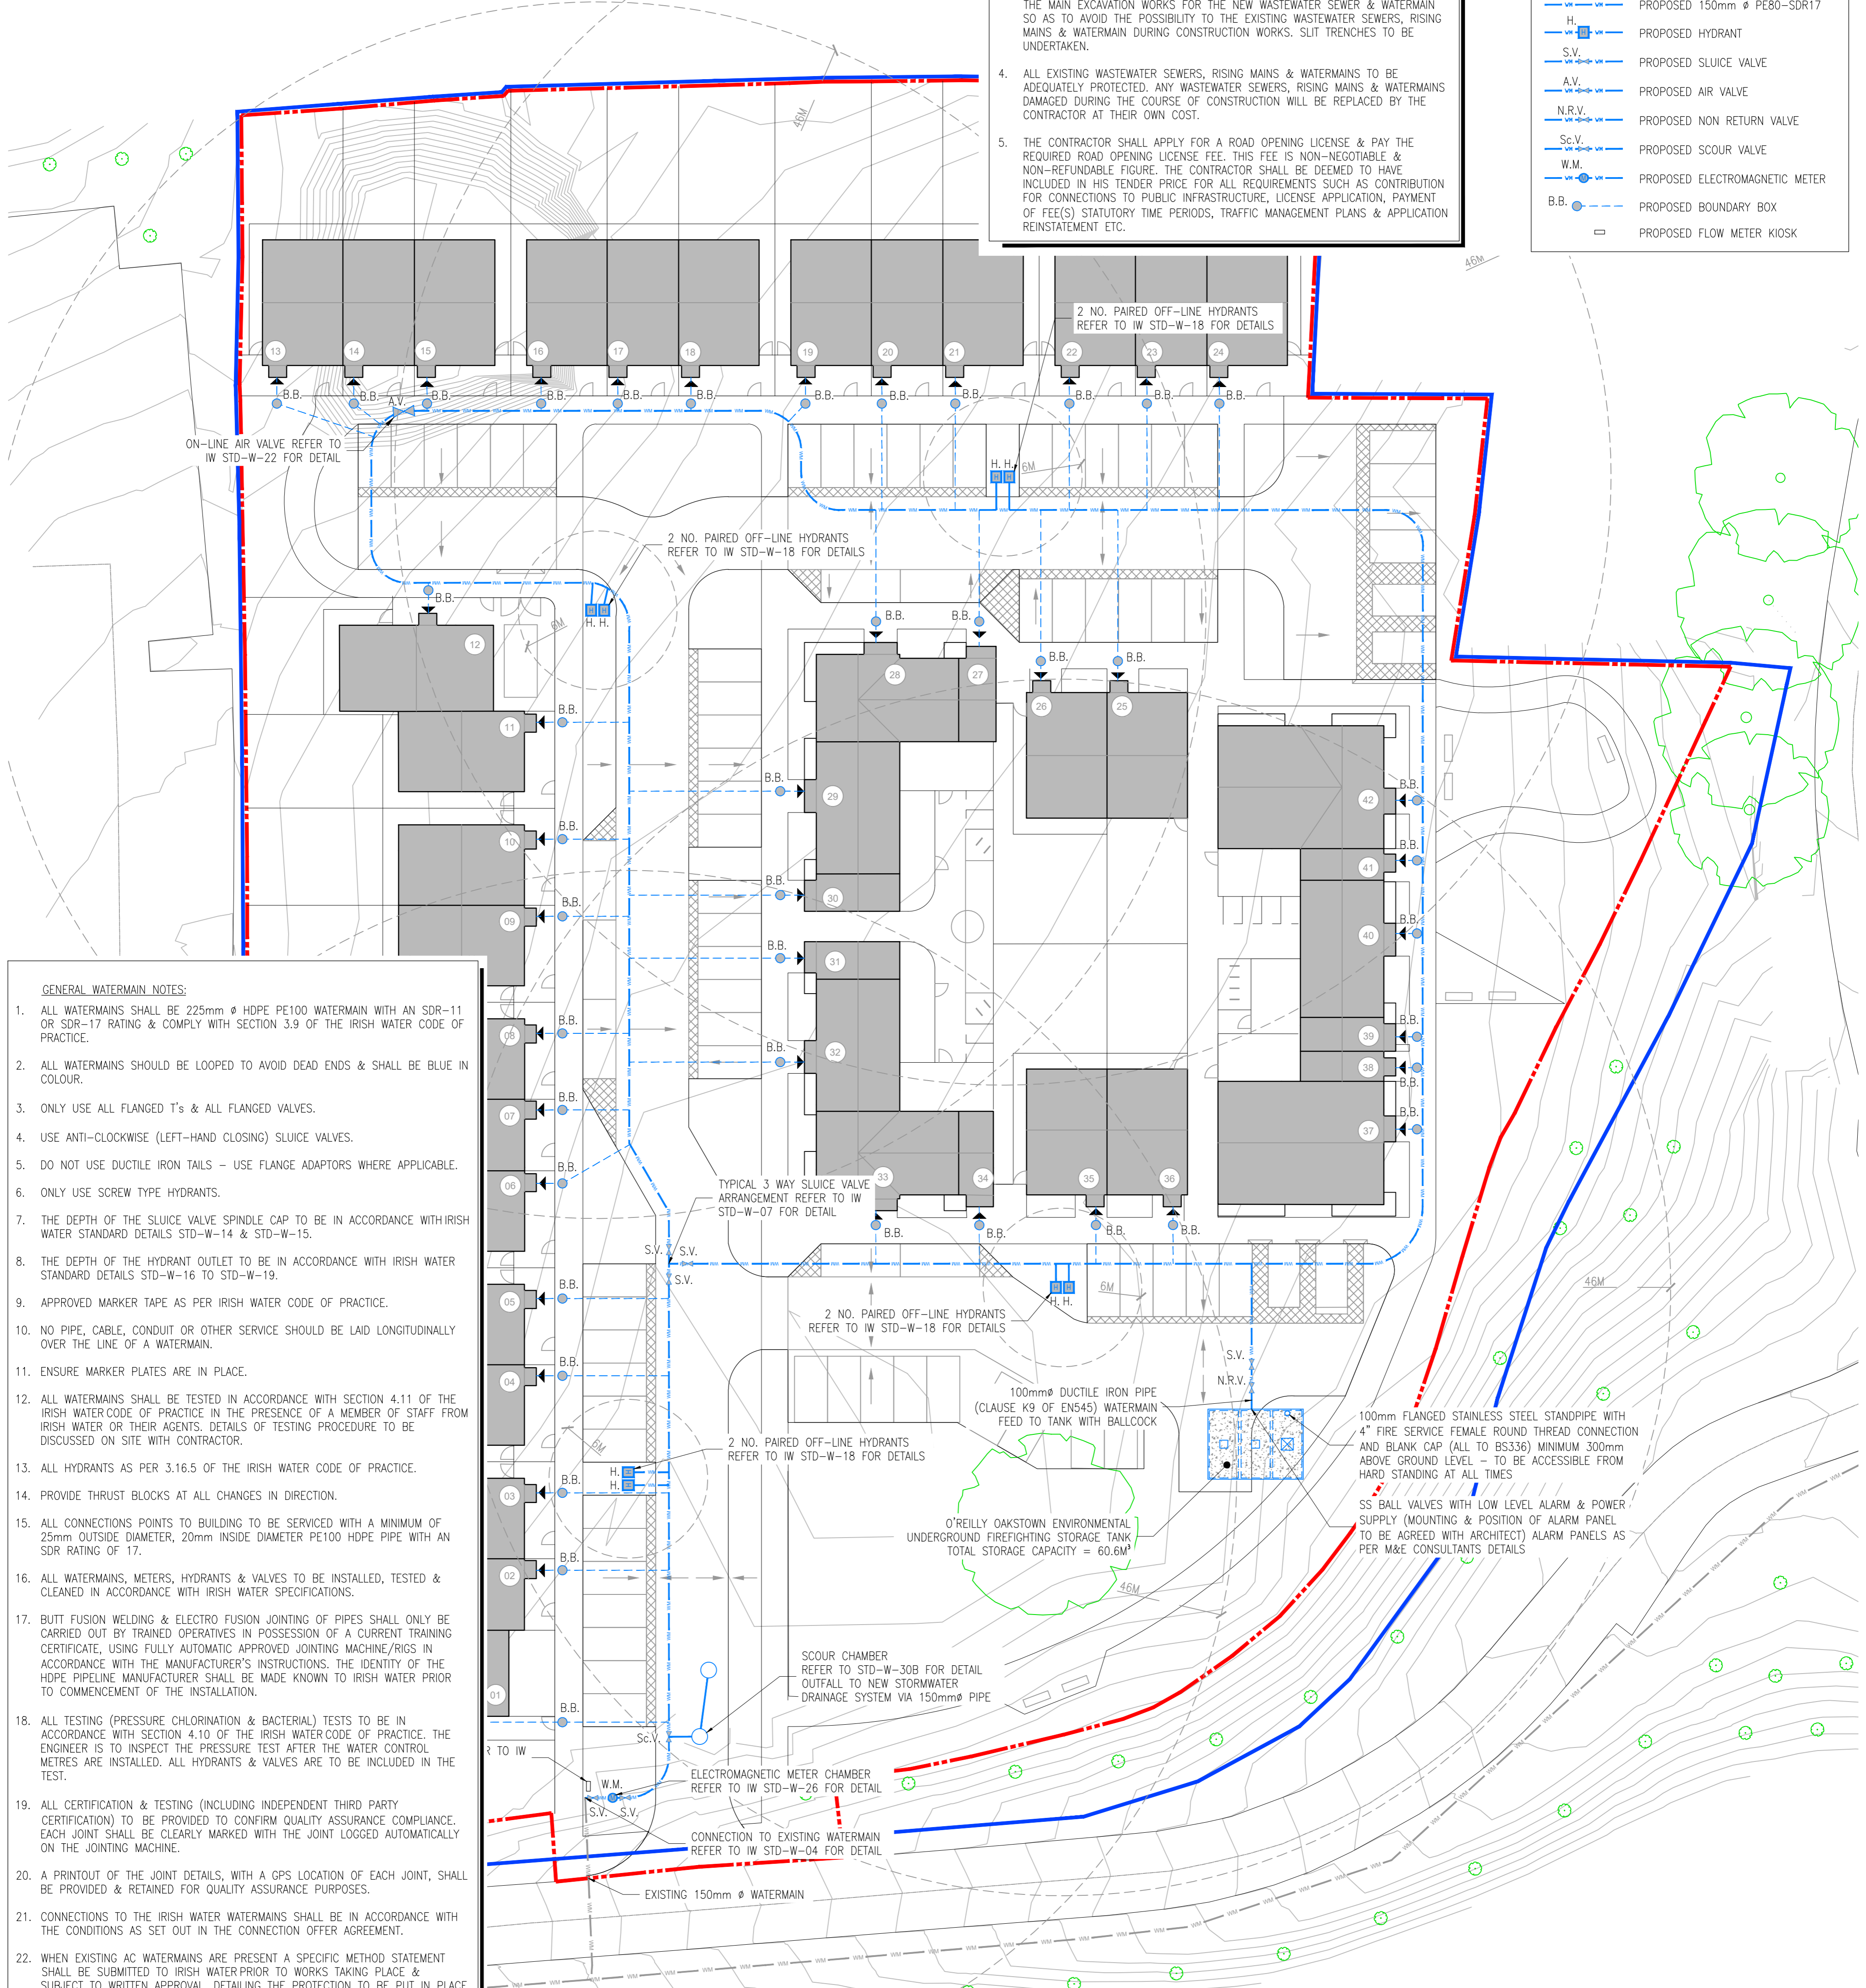

- GENERAL WATERMAIN NOTES:**
- ALL WATERMANS SHALL BE 225mm Ø HDPE PE100 WATERMAIN WITH AN SDR-11 OR SDR-17 RATING & COMPLY WITH SECTION 3.9 OF THE IRISH WATER CODE OF PRACTICE.
 - ALL WATERMANS SHOULD BE LOOPED TO AVOID DEAD ENDS & SHALL BE BLUE IN COLOUR.
 - ONLY USE ALL FLANGED T'S & ALL FLANGED VALVES.
 - USE ANTI-CLOCKWISE (LEFT-HAND CLOSING) SLUICE VALVES.
 - DO NOT USE DUCTILE IRON TAILS - USE FLANGE ADAPTORS WHERE APPLICABLE.
 - ONLY USE SCREW TYPE HYDRANTS.
 - THE DEPTH OF THE SLUICE VALVE SPINDLE CAP TO BE IN ACCORDANCE WITH IRISH WATER STANDARD DETAILS STD-W-14 & STD-W-15.
 - THE DEPTH OF THE HYDRANT OUTLET TO BE IN ACCORDANCE WITH IRISH WATER STANDARD DETAILS STD-W-16 TO STD-W-19.
 - APPROVED MARKER TAPE AS PER IRISH WATER CODE OF PRACTICE.
 - NO PIPE, CABLE, CONDUIT OR OTHER SERVICE SHOULD BE LAID LONGITUDINALLY OVER THE LINE OF A WATERMAIN.
 - ENSURE MARKER PLATES ARE IN PLACE.
 - ALL WATERMANS SHALL BE TESTED IN ACCORDANCE WITH SECTION 4.11 OF THE IRISH WATER CODE OF PRACTICE IN THE PRESENCE OF A MEMBER OF STAFF FROM IRISH WATER OR THEIR AGENTS. DETAILS OF TESTING PROCEDURE TO BE DISCUSSED ON SITE WITH CONTRACTOR.
 - ALL HYDRANTS AS PER 3.16.5 OF THE IRISH WATER CODE OF PRACTICE.
 - PROVIDE THRUST BLOCKS AT ALL CHANGES IN DIRECTION.
 - ALL CONNECTIONS POINTS TO BUILDING TO BE SERVICED WITH A MINIMUM OF 25mm OUTSIDE DIAMETER, 20mm INSIDE DIAMETER PE100 HDPE PIPE WITH AN SDR RATING OF 17.
 - ALL WATERMANS, METERS, HYDRANTS & VALVES TO BE INSTALLED, TESTED & CLEANED IN ACCORDANCE WITH IRISH WATER SPECIFICATIONS.
 - BUTT FUSION WELDING & ELECTRO FUSION JOINTING OF PIPES SHALL ONLY BE CARRIED OUT BY TRAINED OPERATIVES IN POSSESSION OF A CURRENT TRAINING CERTIFICATE, USING FULLY AUTOMATIC APPROVED JOINTING MACHINE/RIGS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. THE IDENTITY OF THE HDPE PIPELINE MANUFACTURER SHALL BE MADE KNOWN TO IRISH WATER PRIOR TO COMMENCEMENT OF THE INSTALLATION.
 - ALL TESTING (PRESSURE CHLORINATION & BACTERIAL) TESTS TO BE IN ACCORDANCE WITH SECTION 4.10 OF THE IRISH WATER CODE OF PRACTICE. THE ENGINEER IS TO INSPECT THE PRESSURE TEST AFTER THE WATER CONTROL METRES ARE INSTALLED. ALL HYDRANTS & VALVES ARE TO BE INCLUDED IN THE TEST.
 - ALL CERTIFICATION & TESTING (INCLUDING INDEPENDENT THIRD PARTY CERTIFICATION) TO BE PROVIDED TO CONFIRM QUALITY ASSURANCE COMPLIANCE. EACH JOINT SHALL BE CLEARLY MARKED WITH THE JOINT LOGGED AUTOMATICALLY ON THE JOINTING MACHINE.
 - A PRINTOUT OF THE JOINT DETAILS, WITH A GPS LOCATION OF EACH JOINT, SHALL BE PROVIDED & RETAINED FOR QUALITY ASSURANCE PURPOSES.
 - CONNECTIONS TO THE IRISH WATER WATERMANS SHALL BE IN ACCORDANCE WITH THE CONDITIONS AS SET OUT IN THE CONNECTION OFFER AGREEMENT.
 - WHEN EXISTING AC WATERMANS ARE PRESENT A SPECIFIC METHOD STATEMENT SHALL BE SUBMITTED TO IRISH WATER PRIOR TO WORKS TAKING PLACE & SUBJECT TO WRITTEN APPROVAL. DETAILING THE PROTECTION TO BE PUT IN PLACE TO EXISTING MAINS, METHOD OF REMOVAL OF EXISTING AC, METHOD OF DISPOSAL OF EXISTING AC & METHOD OF CONNECTION TO EXISTING AC.
 - THE CONTRACTOR IS TO INCLUDE FOR THE EMPLOYMENT OF A CHARTERED ENGINEER WITH PI INSURANCE TO 66.5m TO WITNESS THE INSTALLATION OF ALL AIR TESTS & OTHER IRISH WATER QA AS REQUIRED UNDER THE IRISH WATER QUALITY ASSURANCE (QA) FIELD INSPECTION REQUIREMENTS MANUAL, SEPTEMBER 2017 VERSION 1. IT IS A REQUIREMENT OF THE MAIN CONTRACTOR TO AGREE THE REQUIRED QA WITH THE IRISH WATER FIELD INSPECTORS, RETAIN ALL THE QA DOCUMENTS ON SITE & REPAIR ANY DEFECTS. THE MAIN CONTRACTORS CHARTERED ENGINEERS & THE MAIN CONTRACTOR ARE RESPONSIBLE FOR AGREEING ON SITE CONFORMANCE WITH IRISH WATER PRIOR TO HAND OVER OF THE WORKS TO IRISH WATER. THE PRICE FOR ALL THE ABOVE IS TO BE INCLUDED IN THE MAIN CONTRACTORS TENDER SUM.

- FIREFIGHTING NOTES:**
- FIREFIGHTING TO BE POSITIONED A MINIMUM OF 6m FROM THE PROPOSED BUILDING FOUNDATIONS.
 - LOCATIONS OF FIREFIGHTING AS PER FIRE CERTIFICATE DRAWINGS.
 - FIREFIGHTING TO BE IN ACCORDANCE WITH THE FIRE OFFICER RECOMMENDATIONS WHICH INCLUDES DOUBLING UP OF ALL HYDRANTS IN THIS INSTANCE
 - ALL FIREFIGHTING TO BE LOCATED IN ACCORDANCE WITH TECHNICAL GUIDANCE DOCUMENT B OF BUILDING REGULATIONS, 1997 & TECHNICAL GUIDANCE DOCUMENT B OF BUILDING REGULATIONS, 2006 STATUTORY INSTRUMENT 497 OF 1997.
 - FINAL VERIFICATION SHOULD BE SOUGHT FROM THE FIRE AUTHORITY FOR AGREED LAYOUT OF ALL HYDRANTS & THE NUMBER OF WATER SUPPLY CONNECTIONS TO THE FIRE WATER RING MAIN.

PROPOSED WATERMAIN LAYOUT
SCALE 1:250 @ A1 / 1:500 @ A3

Status: **PRELIMINARY**

PROPOSED WATERMAIN LAYOUT

Date: 09.05.23 Scale: A1 @ 1:250 / A3 @ 1:500

Drawn By: G.GOODSON Checked By: T.DELANEY Approved By: N.PATTERSON

Client: **KILKENNY COUNTY COUNCIL**

Job Description: **HOUSING DEVELOPMENT THOMASTOWN, CO.KILKENNY**

Project No: 22KK022 Drawing Ref: C-010 Rev: P1

Hayes Higgins Partnership

Gas House Lane, Kilkenny.

056 7784710 056 7723223 info@hayeshiggins.com

- NOTES:**
- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, SERVICE ENGINEERS DRAWINGS & SPECIFICATIONS.
 - ALL LEVELS ARE STRUCTURAL UNLESS NOTED OTHERWISE
 - ALL WORKS TO BE CARRIED OUT IN ACCORDANCE WITH THE RELEVANT BUILDING REGULATIONS.
 - DO NOT SCALE - WORK TO FIGURE DIMENSIONS ONLY.

QUALITY ISO 9001:2000 NSAI Certified

ENGINEERS IRELAND

cpd ACCREDITED COMPANY

© HAYES HIGGINS PARTNERSHIP

Issue register					
Rev.	Date	Description	Drawn	Checked	Approved
01	31.05.23	PRELIMINARY ISSUE	GG	TD	NP